

MF-1

1981 ANNUAL



JAIL INSPECTION REPORT

85813

Carlin
governor

Patrick D. McManus
Secretary of Corrections

State of Kansas

JOHN CARLIN
Governor

Kansas Department of Corrections

PATRICK D. McMANUS
Secretary

1981 ANNUAL JAIL INSPECTION REPORT

DEPUTY SECRETARY OF COMMUNITY SERVICES

JOSEPH A. RUSKOWITZ

COMMUNITY FACILITIES AND SERVICES ADMINISTRATOR

HAROLD D. SAMUELS

U.S. Department of Justice
National Institute of Justice

This document has been reproduced exactly as received from the person or organization originating it. Points of view or opinions stated in this document are those of the authors and do not necessarily represent the official position or policies of the National Institute of Justice.

Permission to reproduce this ~~copyrighted~~ material has been granted by
Kansas Department of Corrections

to the National Criminal Justice Reference Service (NCJRS).

Further reproduction outside of the NCJRS system requires permission of the ~~copyright~~ owner.

CORRECTIONAL FACILITIES SPECIALISTS

Eastern Region

MAX R. GILMORE

Western Region

LARRY E. DIXON

NCJRS

SEP 30 1982

ACQUISITIONS

TABLE OF CONTENTS

	<u>PAGE NO.</u>
DEFINITION OF TERMS-----	01
MAP OF JUDICIAL DISTRICTS-----	02
A GENERAL OVERVIEW OF THE STATUS OF LOCAL CONFINEMENT FACILITIES Distribution of Facilities by Age Group-----	03
FACILITIES IN THE PLANNING PROCESS, FACILITIES UNDERGOING MAJOR RENOVATION, FACILITIES UNDERGOING NEW CONSTRUCTION AND JAILS NO LONGER IN USE-----	07
MEETINGS RECOMMENDED BY THE SECRETARY OF CORRECTIONS, PURSUANT TO K.S.A. 75-5228-----	09
FACILITIES THAT MEET THE KANSAS ADVISORY JAIL STANDARDS AND PROCEDURES BY JUDICIAL DISTRICTS-----	11
FIRST JUDICIAL DISTRICT-----	12
SECOND JUDICIAL DISTRICT-----	12
FOURTH JUDICIAL DISTRICT-----	12
FIFTH JUDICIAL DISTRICT-----	12
SIXTH JUDICIAL DISTRICT-----	12
SEVENTH JUDICIAL DISTRICT-----	12
EIGHTH JUDICIAL DISTRICT-----	13
TENTH JUDICIAL DISTRICT-----	13
ELEVENTH JUDICIAL DISTRICT-----	13
TWELFTH JUDICIAL DISTRICT-----	13
THIRTEENTH JUDICIAL DISTRICT-----	14
FOURTEENTH JUDICIAL DISTRICT-----	14
EIGHTEENTH JUDICIAL DISTRICT-----	14
NINETEENTH JUDICIAL DISTRICT-----	14
TWENTIETH JUDICIAL DISTRICT-----	14
TWENTY-FIRST JUDICIAL DISTRICT-----	14
TWENTY-SECOND JUDICIAL DISTRICT-----	15
TWENTY-THIRD JUDICIAL DISTRICT-----	15
TWENTY-FIFTH JUDICIAL DISTRICT-----	15
TWENTY-SIXTH JUDICIAL DISTRICT-----	15
TWENTY-NINTH JUDICIAL DISTRICT-----	15

PAGE NO.

OPERATIONAL CONFINEMENT FACILITIES WITH DEFICIENCIES BY JUDICIAL DISTRICTS -----	16
FIRST JUDICIAL DISTRICT-----	17
SECOND JUDICIAL DISTRICT-----	19
THIRD JUDICIAL DISTRICT-----	21
FOURTH JUDICIAL DISTRICT-----	22
SIXTH JUDICIAL DISTRICT-----	23
EIGHTH JUDICIAL DISTRICT-----	24
NINTH JUDICIAL DISTRICT-----	25
ELEVENTH JUDICIAL DISTRICT-----	26
TWELFTH JUDICIAL DISTRICT-----	29
THIRTEENTH JUDICIAL DISTRICT-----	31
FOURTEENTH JUDICIAL DISTRICT-----	32
FIFTEENTH JUDICIAL DISTRICT-----	33
SIXTEENTH JUDICIAL DISTRICT-----	34
SEVENTEENTH JUDICIAL DISTRICT-----	36
EIGHTEENTH JUDICIAL DISTRICT-----	38
NINETEENTH JUDICIAL DISTRICT-----	39
TWENTIETH JUDICIAL DISTRICT-----	40
TWENTY-SECOND JUDICIAL DISTRICT-----	42
TWENTY-THIRD JUDICIAL DISTRICT-----	43
TWENTY-FOURTH JUDICIAL DISTRICT-----	44
TWENTY-FIFTH JUDICIAL DISTRICT-----	46
TWENTY-SIXTH JUDICIAL DISTRICT-----	47
TWENTY-SEVENTH JUDICIAL DISTRICT-----	49
TWENTY-EIGHTH JUDICIAL DISTRICT-----	50
TWENTY-NINTH JUDICIAL DISTRICT-----	51
MOST COMMON DEFICIENCIES ENCOUNTERED-----	52

PAGE NO.

FACILITIES THAT MEET THE KANSAS ADVISORY JAIL STANDARDS AND PROCEDURES-----	11
OPERATIONAL FACILITIES IN ALPHABETICAL ORDER	
JAILS	
Bourbon County-----	12
Butler County-----	14
Clay County-----	14
Cloud County-----	13
Dickinson County-----	13
Douglas County-----	12
Elk County-----	14
Franklin County-----	12
Harper County-----	14
Johnson County-----	13
Kansas City, Kansas, City Facility-----	15
Kingman County-----	14
Linn County-----	12
Lyon County-----	12
Marion County-----	13
Mitchell County-----	13
Nemaha County-----	15
Pratt County-----	14
Riley County-----	14
Stanton County-----	15
Stevens County-----	15
Thomas County-----	14
Trego County-----	15
Wilson County-----	14
Woodson County-----	12
LOCKUPS	
Anderson County-----	12
Arkansas City City-----	14
Coffeyville City-----	14
Eureka City-----	14
Galena City-----	13
Garden City, City-----	15
Greeley County-----	15
Haskell County-----	15
Herington City-----	13
Holton City-----	12
Junction City, City-----	13
Parsons City-----	13
Pittsburg City-----	13
Wallace County-----	15
Wichita County-----	15
Winfield City-----	14

HOLDING

Atchison City-----	12
Bonner Springs City-----	15
Chanute City-----	13
Coffey County-----	12
Douglas City-----	12
Haysville City-----	13
Hoisington City-----	14
Leawood City-----	13
Neodesha City-----	13
Johnson County Northeast Facility-----	13
Osage City-----	12
Osage County-----	12
Overland Park-----	13
Prairie Village-----	13
Russell City-----	14
Shawnee City-----	13
Stafford County-----	13
Wilson City-----	14

OPERATIONAL CONFINEMENT FACILITIES WITH DEFICIENCIES-----16

JAILS

Allen County-----	22
Atchison County-----	17
Barber County-----	39
Barton County-----	40
Cherokee County-----	26
Clark County-----	34
Cowley County-----	39
Crawford County-----	26
Decatur County-----	36
Doniphan County-----	42
Edwards County-----	44
Ellis County-----	43
Ellsworth County-----	40
Ford County-----	34
Geary County-----	24
Graham County-----	33
Grant County-----	47
Greenwood County-----	31
Harvey County-----	25
Hodgeman County-----	44
Jackson County-----	19
Jefferson County-----	19
Kearny County-----	46
Kiowa County-----	35
Labette County-----	27
Lane County-----	44

OPERATIONAL CONFINEMENT FACILITIES WITH DEFICIENCIES-----16
(Continued)

Leavenworth County-----	18
Lincoln County-----	29
Marshall County-----	42
Meade County-----	35
Miami County-----	23
Montgomery County-----	32
Morris County-----	24
Morton County-----	47
McPherson County-----	25
Neosho County-----	28
Ness County-----	45
Norton County-----	36
Osborne County-----	36
Ottawa County-----	50
Pawnee County-----	45
Pottawatomie County-----	20
Rawlins County-----	36
Reno County-----	49
Republic County-----	29
Rice County-----	40
Rooks County-----	33
Russell County-----	41
Saline County-----	50
Scott County-----	46
Sedgwick County-----	38
Seward County-----	48
Shawnee County-----	21
Sherman County-----	21
Smith County-----	36
Sumner County-----	39
Wabaunsee County-----	20
Washington County-----	30
Wyandotte County-----	51

LOCKUPS

Baxter Springs City-----	28
Cheyenne County-----	37
Oakley City-----	43


HOLDING

Augusta City-----	31
Horton City-----	42
Mulvane City-----	38

DEFINITION OF TERMS

- JAIL-----A facility operated by a unit of local government for the physical detention or confinement, for a period of one year or less, of persons charged with, or convicted of, criminal offenses.
- LOCKUP-----A facility operated by a unit of local government for the physical detention or confinement, for a period of seventy-two hours or less, of persons charged with, or convicted of, criminal offenses.
- HOLDING FACILITY-----A facility operated by a unit of local government for the temporary physical detention of persons awaiting processing, booking, appearance before a court of competent jurisdiction, or discharge.
- CAPACITY-----The bed space for which the facility was originally designed to accommodate.
- RECOMMENDED CAPACITY--The bed space that should be available using a formula of fifty-two square feet of cell space per bed for existing facilities.
- URGENT-----A situation or hazard which presents an immediate threat to the health and safety of inmates or employees, or the potential for escape.
- NECESSARY-----A situation or hazard which presents a potential threat to the health and safety of inmates or employees if they are continually exposed over a prolonged period.
- DESIRABLE-----A condition which does not present an immediate or potential threat to the health and safety of inmates or employees; but which, if changed, would improve the habitability of the facility or the staff's management abilities.

STATE OF KANSAS
DIVISION BY JUDICIAL DISTRICTS

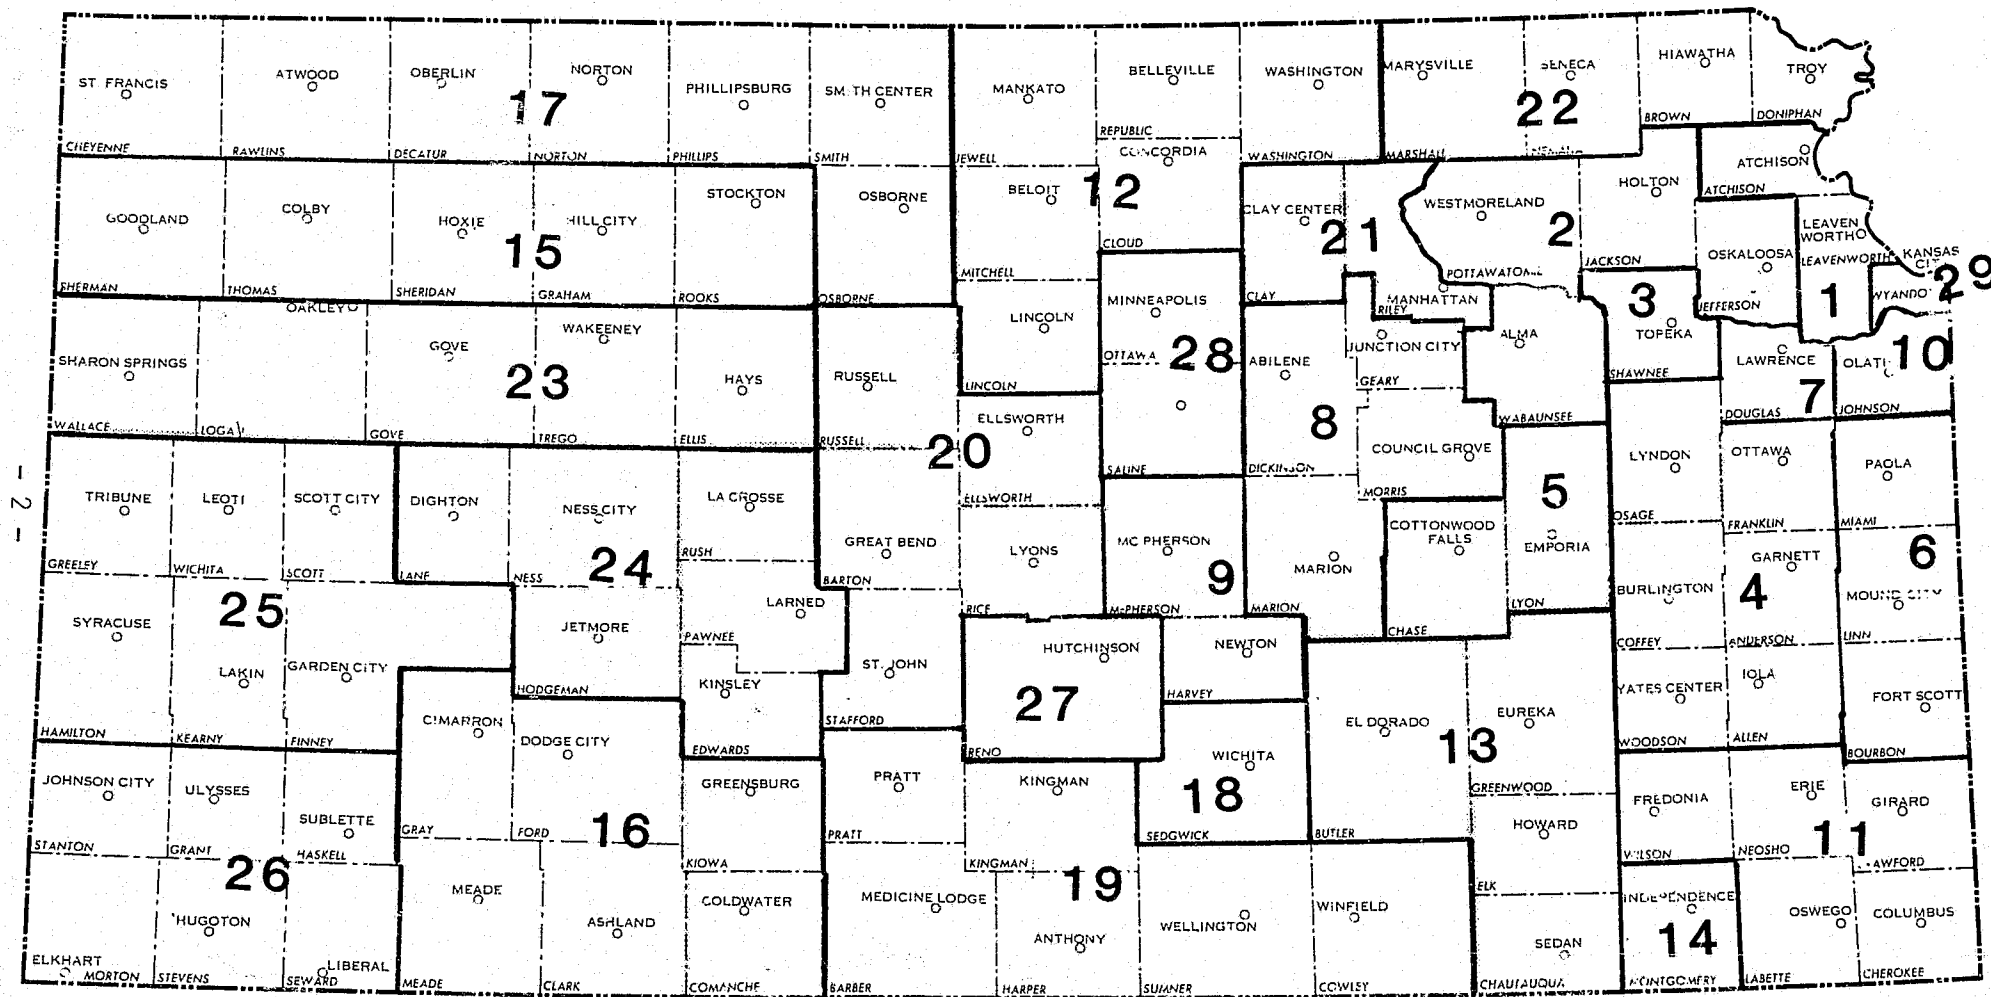

A GENERAL OVERVIEW OF THE STATUS OF LOCAL CONFINEMENT FACILITIES

As enumerated in K.S.A. 1981 Supp. 75-5228, the Secretary of Corrections is given three major responsibilities in performing the jail inspection function.

1. The promulgation of advisory standards relating to the sanitation and safety of correctional institutions and jails.
2. The periodic inspection of correctional institutions and jails.
3. The presentation of evidence to local officials and judicial personnel that a particular facility, within their jurisdiction, needs major improvement or should be closed.

The program responsibility entails on-site inspection of jails, including such basic areas as security, safety, sanitation and inmate services. The program staff also provides technical assistance and investigates complaints concerning the operation of jails and/or treatment of prisoners.

During 1981 the Jail Inspection Staff responded to requests from Washburn University and various counties in the state as participating consultants for jail staff training.

The Kansas Statute that requires inspections of Jail/Detention facilities also authorizes the Secretary of Corrections to request the aid of the State Fire Marshal's office and the State Department of Health and Environment. During calendar year 1981 the Jail Inspection Staff requested and coordinated twenty-six (26) joint inspections with the State Fire Marshal's office and seven (7) with the State Department of Health and Environment, the joint inspection requests had decreased from sixty-three (63) and twelve (12) or a 58% and 41% decrease respectively from 1980. These joint inspections are

requested because of serious problems in the Jail/Detention facilities that pertain to a particular field of expertise. The requests for joint inspections have been reduced as local authorities have steadily reduced their serious jail deficiencies in Fire Safety and Sanitation.

The Jail Inspection Staff investigated twenty-six (26) letters of complaint from individual inmates and/or their friends. The majority of these complaints were forwarded from the offices of the Governor and the Attorney General. There were fifty-five (55) allegations derived from the twenty-six (26) complaints but only six (6) of these allegations or 10.9% were found to be valid. The valid allegations covered primarily the areas of sanitation and food service. The number of complaints received in 1981 has increased by one over those received in 1980. The number of allegations against the facilities decreased from sixty-one (61) to fifty-five (55) or a 6.1% decrease, and the number of allegations found to be valid decreased from nineteen (19) to six (6). The percentage of valid allegations decreased from 31% to 10.9%. The number of complaints against Jail/Detention facilities has remained on a steady decline each year. The decrease in severe allegations against jail facilities this year is not inconsistent with the steady decline from previous years.

Throughout 1981 the Jail Inspection Staff made seventy-seven (77) on-site contacts to provide technical assistance with respect to the custody, care and treatment of inmates. These contacts included review and comment on plans for the construction or major modification of local Jail/Detention facilities. The number of requests for technical assistance has increased by 26% over the amount for 1980.

Inspections were made during 1981 of a total of one hundred twenty-four (124) operational Jail/Detention facilities. Of this one hundred twenty-four (124) total it was discovered that Kansas had eight-four (84) jails, nineteen (19) lockups, and twenty-one (21) holding facilities operating within the one hundred five (105) counties. The total number of operational jails has increased by one over 1980 due to the renovation and reopening of a previously closed facility. There are an additional twelve (12) Jail/Detention facilities that are not included in the operational list because of undergoing major renovation, new construction or closures due to various other reasons.

Distribution of Facilities by Age Group

Age of Facility	Jails	Lockups	Holding Facilities	TOTAL
1 year or less	4	0	0	4
2 - 10 years	21	7	8	36
11 - 20 years	12	5	6	23
21 - 30 years	20	0	0	20
31 - 40 years	7	1	2	10
41 - 50 years	11	2	1	14
51 - 60 years	7	3	3	13
61 - 70 years	1	1	1	3
71 - 80 years	1	0	0	1

At the close of the calendar year 1981, there were 84 jails, 19 lockups, and 21 holding facilities operating within the 105 counties. Combined, these facilities confined an average of 1,612 individuals on any given day in 1981. The facilities range in age from 1 year to 81 years, with a mean age of 24.2 years as derived from group data. The total bed space for the combined jail/detention facilities is 2,557. The bed space for facilities holding up to one year is 2,241, with the recommended total bed space as derived from the Kansas Jail Standards regarding minimum cell space per inmate, for this type of facility being 1864.

FACILITIES IN THE PLANNING PROCESS,
FACILITIES UNDERGOING MAJOR RENOVATION,
FACILITIES UNDERGOING NEW CONSTRUCTION,

AND

JAILS NO LONGER IN USE

Listed below are the jail/detention facilities that were identified in 1981 as no longer in use:

JAILS

1. Brown County
2. Chautauqua County
3. Chase County
4. Commanche County
5. Finney County
6. Gove County
7. Gray County
8. Hamilton County
9. Jewell County
10. Phillips County
11. Rush County
12. Sheridan County

Listed below are facilities that are in the planning stage, undergoing major renovation or under construction:

PLANNING NEW FACILITIES

1. Geary County
2. Hamilton County
3. Jackson County
4. Jewell County
5. Labette County
6. Shawnee County

PLANNING MAJOR RENOVATION

1. Clark County
2. Oakley City Lockup
3. Russell County
4. Scott County

UNDER NEW CONSTRUCTION

1. Brown County
2. Finney County
3. Pottawatomie County

UNDER MAJOR RENOVATION

1. Geary County
2. Phillips County

MEETINGS RECOMMENDED BY THE SECRETARY
OF CORRECTIONS, PURSUANT TO K.S.A. 1981 SUPP. 75-5228
REGARDING FACILITIES WITH SERIOUS DEFICIENCIES
CONSIDERED TO BE A DETRIMENT TO HUMAN LIFE

During 1981 the Jail Inspection Staff identified twenty-six (26) facilities that contained serious deficiencies that could be a detriment to human life. This was a decrease of eight (8) or 23% from the thirty-four (34) facilities identified in 1980. By the end of 1981, fourteen (14) local governments had held meetings with the Secretary of Corrections or his designee, a remaining four (4) local governments scheduled meetings that will be held in calendar year of 1982. The fourteen (14) meetings held in 1981 resulted in a concensus from the local authorities to correct the deficiencies rated as urgent and necessary.

Effective July 1, 1981 K.S.A. 75-5228 was changed to require the Secretary of Corrections to request the meeting, serve as chairperson and establish the date, time and place of the meeting.

FACILITIES IDENTIFIED IN 1981 AS HAVING DEFICIENCIES THAT
COULD BE A DETRIMENT TO HUMAN LIFE

- | | |
|---------------------------|---------------------------|
| 1. Atchison County Jail | 14. Jackson County Jail |
| 2. Augusta City Holding | 15. Jefferson County Jail |
| 3. Baxter Springs Lockup | 16. Labette County Jail |
| 4. Cheyenne County Lockup | 17. Meade County Jail |
| 5. Clark County Jail | 18. Morton County Jail |
| 6. Crawford County Jail | 19. McPherson County Jail |
| 7. Edwards County Jail | 20. Republic County Jail |
| 8. Ellsworth County Jail | 21. Rice County Jail |
| 9. Ford County Jail | 22. Russell County Jail |
| 10. Geary County Jail | 23. Scott County Jail |
| 11. Greenwood County Jail | 24. Shawnee County Jail |
| 12. Harvey County Jail | 25. Sumner County Jail |
| 13. Hodgeman County Jail | 26. Wyandotte County Jail |

LOCAL GOVERNMENTS RESPONDING TO REQUESTS FOR MEETINGS
WITH THE SECRETARY OF CORRECTIONS

- | | |
|---------------------|----------------------|
| 1. Atchison County | 10. Jackson County |
| 2. Augusta | 11. Jefferson County |
| 3. Baxter Springs | 12. Labette County |
| 4. Cheyenne County | 13. McPherson County |
| 5. Crawford County | 14. Rice County |
| 6. Ellsworth County | 15. Russell County |
| 7. Geary County | 16. Shawnee County |
| 8. Greenwood County | 17. Sumner County |
| 9. Harvey County | 18. Wyandotte County |

FACILITIES THAT MEET THE
KANSAS ADVISORY JAIL STANDARDS AND PROCEDURES

LISTED BY JUDICIAL DISTRICT
 ARE THE FACILITIES THAT
 MEET THE KANSAS JAIL STANDARDS AND PROCEDURES

	<u>Date of Construction</u>	<u>Average Daily Population</u>
<u>First Judicial District</u>		
Atchison City Holding	1939	Less than one
<u>Second Judicial District</u>		
Holton City Lockup	1977	Less than one
<u>Fourth Judicial District</u>		
Franklin County Jail	1972	12
Woodson County Jail	1969	Less than one
Anderson County Lockup	1926	Less than one
Coffey County Holding	1923	Less than one
Osage County Holding	1923	Less than one
Osage City Holding	unknown	Less than one
<u>Fifth Judicial District</u>		
Lyon County Jail	1977	17
<u>Sixth Judicial District</u>		
Bourbon County Jail	1977	22
Linn County Jail	1979	3
<u>Seventh Judicial District</u>		
Douglas County Jail	1976	37

	<u>Date of Construction</u>	<u>Average Daily Population</u>
<u>Eighth Judicial District</u>		
Dickinson County Jail	1956	9
Marion County Jail	Renovated 1981	7
Junction City Lockup	1977	7
Herington City Lockup	1976	Less than one
<u>Tenth Judicial District</u>		
Johnson County Jail	Renovated 1974	87
Leawood City Holding	1972	Less than one
Northeast Facility Holding	1973	2
Overland Park Holding	1975	2
Prairie Village Holding	1970	Less than one
Shawnee City Holding	1979	Less than one
<u>Eleventh Judicial District</u>		
Galena City Lockup	1978	Less than one
Parsons City Lockup	1937	Less than one
Pittsburg City Lockup	1969	Less than one
Chanute City Holding	1925	Less than one
Neodesha City Holding	1980	Less than one
<u>Twelfth Judicial District</u>		
Cloud County Jail	Renovated 1978	6
Mitchell County Jail	1959	4

	<u>Date of Construction</u>	<u>Average Daily Population</u>
<u>Thirteenth Judicial District</u>		
Butler County Jail	1971	20
Douglas City Holding	1966	Less than one
Elk County Jail	1960	5
Eureka City Lockup	1966	Less than one
<u>Fourteenth Judicial District</u>		
Coffeyville City Lockup	1964	3
<u>Fifteenth Judicial District</u>		
Thomas County Jail	1976	6
<u>Eighteenth Judicial District</u>		
Haysville City Holding	1979	Less than one
<u>Nineteenth Judicial District</u>		
Pratt County Jail	1976	10
Arkansas City Lockup	Renovated 1977	Less than one
Winfield City Lockup	1963	Less than one
Kingman County Jail	Renovated 1980	1
Harper County Jail	1977	5
<u>Twentieth Judicial District</u>		
Hoisington City Holding	1939	Less than one
Russell City Holding	Renovated 1979	Less than one
Stafford County Holding	1977	1
Wilson City Holding	1964	Less than one
<u>Twenty-First Judicial District</u>		
Riley County Jail	Renovated 1976	18
Clay County Jail	1981	5

	<u>Date of Construction</u>	<u>Average Daily Population</u>
<u>Twenty-Second Judicial District</u>		
Nemaha County Jail	1978	4
<u>Twenty-Third Judicial District</u>		
Trego County Jail	1980	4
Wallace County Lockup	Renovated 1977	Less than one
<u>Twenty-Fifth Judicial District</u>		
Garden City Lockup	1920	2
Greeley County Lockup	1975	Less than one
Wichita County Lockup	1972	Less than one
<u>Twenty-Sixth Judicial District</u>		
Stanton County Jail	1978	2
Stevens County Jail	1952	2
Haskell County Lockup	1978	Less than one
<u>Twenty-Ninth Judicial District</u>		
Kansas City, Kansas City Jail	1969	18
Bonner Springs City Holding	Renovated 1977	Less than one

JAILS-LOCKUPS-HOLDING FACILITIES

WITH DEFICIENCIES

BY JUDICIAL DISTRICT

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	FIRST JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
ATCHISON COUNTY JAIL*	1941	19	12	3	(01) Hazardous materials and/or equipment in cell area.** (02) Electrical cords and/or fixtures accessible to inmates.** (03) Inadequate administrative space.** (04) Inadequate ventilation.** (05) Cell areas do not maintain fifty-two (52) square feet per inmate.** (06) No emergency power.** (07) Does not maintain adequate separation of inmates.** (08) No detoxification cell. (09) Inadequate and/or improper plumbing fixtures.** (10) No standard inmate clothing issued.** (11) No exercise area.** (12) Painted surfaces need repainting.** (13) Overall sanitation needs to be improved.** (14) No thirty (30) day menu available.	X X	X X X X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	FIRST JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
LEAVENWORTH COUNTY JAIL*	1938	65	65	37	(01) Does not maintain adequate separation of inmates.** (02) Inadequate interior lighting.** (03) Inadequate and/or improper plumbing fixtures.** (04) No security and/or insect screens on windows. (05) Cold storage units are not provided with thermometers. (06) No exercise area.** (07) No floor drains in cell block areas.** (08) Some painted surfaces need repainting.**		X X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	SECOND JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
JACKSON COUNTY JAIL*	1929	16	10	6	(01) Does not comply with State Fire Marshal's regulations.** (02) Electrical cords and/or fixtures are accessible to inmates. (03) Inadequate ventilation.** (04) Cell areas do not maintain fifty-two (52) square feet per inmate.** (05) Does not maintain adequate separation of inmates. (06) Inadequate interior lighting.** (07) Inadequate and/or improper plumbing fixtures.** (08) No standard inmate clothing issued.** (09) No exercise area. (10) Painted surfaces need repainting.** (11) Insect screens need repair.	X		
JEFFERSON COUNTY JAIL*	1932	14	14	6	(01) Hazardous materials and/or equipment in cell areas. (02) Inadequate administrative space.** (03) Inadequate ventilation.** (04) Inadequate and/or improper plumbing fixtures. (05) Inadequate consultation and visitation area. (06) Painted surfaces need repainting. (07) No standard inmate clothing issued.** (08) No exercise area.**	X	X	X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	SECOND JUDICIAL DISTRICT			
					DEFICIENCIES			
					URGENCY	NECESSARY	DESIRABLE	
POTTAWATOMIE COUNTY JAIL*	1970	18	11	6	(01) No written safety, security and emergency procedures. (02) Inadequate administrative space.** (03) No detoxification cell. (04) Cell areas do not maintain fifty-two (52) square feet per inmate. (05) Inadequate consultation and visitation area.** (06) Does not maintain adequate separation of inmates.** (07) Painted surfaces need repainting.	X	X X X X X	X
WABAUNSEE COUNTY JAIL*	1900	18	18	6	(01) Inadequate ventilation.** (02) No detoxification cell.** (03) Inadequate consultation and visitation area. (04) No emergency power.** (05) Does not maintain adequate separation of inmates.** (06) Inadequate and/or improper plumbing fixtures.** (07) No security and/or insect screens on windows. (08) No secure storage for weapons. (09) No exercise area.** (10) No floor drains in cell block areas.**		X X X X X X X X	X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>THIRD JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
SHAWNEE COUNTY JAIL*	1965	96	65	105	(01) Inadequate inmate supervision. (02) Improper security equipment. (03) Inadequate key control. (04) Inadequate security control. (05) Inadequate administrative space.** (06) Inadequate ventilation.** (07) Inadequate interior lighting.** (08) Cell areas do not maintain fifty-two (52) square feet per inmate.** (09) Does not maintain adequate separation of inmates.** (10) Inadequate consultation and visitation areas.** (11) Inadequate storage space. (12) Inadequate exercise area. (13) Painted surfaces need repainting.** (14) Overall sanitation needs to be improved.** (15) Inadequate floor drains. (16) Too many inmates in dormitories.**	X X X X	X X X X X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>FOURTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
ALLEN COUNTY JAIL*	1958	12	12	11	(01) Inadequate matron supervision of female inmates.	X		

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>SIXTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
MIAMI COUNTY JAIL*	1967	22	22	12	(01) Inadequate interior lighting. (02) Inadequate and/or improper plumbing fixtures. (03) Does not provide three (3) meals daily.** (04) Inadequate consultation and visitation area.** (05) No exercise area.** (06) No smoke detectors.**		X X X X	X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	EIGHTH JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
GEARY COUNTY JAIL*	1951	45	21	45	(01) Does not comply with State Fire Marshal's regulations. (02) Inadequate supervision of inmates.** (03) Inadequate administrative space. (04) Inadequately equipped processing area.** (05) Cell areas do not maintain fifty-two (52) square feet per inmate.** (06) Inadequate consultation and visitation area.** (07) No emergency power.** (08) Does not maintain adequate separation of inmates.** (09) No detoxification cell.** (10) Inadequate and/or improper plumbing fixtures.** (11) Inadequate weapon storage.**	X X	X X X X X X X	
MORRIS COUNTY JAIL*	1969	8	4	1	(01) Hazardous materials and/or equipment in cell areas. (02) Inadequate administrative space.** (03) Does not maintain adequate separation of inmates.** (04) Cell areas do not maintain fifty-two (52) square feet per inmate.** (05) Inadequate interior lighting.** (06) Inadequate consultation and visitation area. (07) No standard inmate clothing issued.** (08) No exercise area.** (09) Painted surfaces need repainting.**	X	X X X X X	X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	NINTH JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
HARVEY COUNTY JAIL*	1965	46	28	18	(01) Does not comply with State Fire Marshal's regulations.** (02) Electrical cords and/or fixtures are accessible to inmates.** (03) Correctional personnel physical standards are not maintained. (04) Cell areas do not maintain fifty-two (52) square feet per inmate.** (05) Inadequate interior lighting.** (06) Does not comply with Department of Health and Environment standards.** (07) No intercom system between jail office and cell block areas.** (08) No exercise area.**	X X X	X X X	X
McPHERSON COUNTY JAIL*	1958	27	27	15	(01) Inadequate supervision of inmates.** (02) Does not comply with State Fire Marshal's regulations. (03) Electrical cords and/or fixtures are accessible to inmates. (04) Inadequate heating and ventilation. (05) No emergency power. (06) Intercom system partially inoperable. (07) Does not provide three (3) meals daily.** (08) No detoxification cell. (09) No exercise area.** (10) Painted surfaces need repainting.	X X X	X X X X	X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>ELEVENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
CHEROKEE COUNTY JAIL*	1950	14	14	6	(01) No emergency power.** (02) Inadequate visitation and consultation area.** (03) Inadequate and/or improper plumbing fixtures. (04) No detoxification cells.** (05) No security and/or insect screens on windows.** (06) No standard inmate clothing issued.** (07) No exercise area.**		X X X X	X X
CRAWFORD COUNTY JAIL*	1925	19	19	10	(01) Hazardous material and/or equipment in cell areas. (02) Electrical cords and/or fixtures are accessible to inmates. (03) Inadequate administrative space.** (04) No emergency power. (05) No detoxification cell. (06) Inadequate and/or improper plumbing fixtures. (07) No floor drains in cell block areas. (08) Painted surfaces need repainting.**	X X	X X X X	X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	ELEVENTH JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
LABETTE COUNTY JAIL*	1950	24	12	12	(01) Does not comply with State Fire Marshal's regulations.** (02) Hazardous materials and/or equipment in cells.** (03) Electrical cords and/or fixtures are accessible to inmates.** (04) Security equipment in need of repair or replacement.** (05) Inadequate ventilation.** (06) Cell areas do not maintain fifty-two (52) square feet per inmate.** (07) No holding cell.** (08) No detoxification cells.** (09) Does not maintain adequate separation of inmates.** (10) Inadequate interior lighting.** (11) Inadequate and/or improper plumbing fixtures.** (12) No security and/or insect screens on windows.** (13) Too many inmates in dormitories.** (14) Inadequate consultation and visiting area.** (15) No exercise area.** (16) No floor drains in cell block areas.** (17) Painted surfaces need repainting.** (18) No smoke detection system.**	X X X X	X X X X X X X X X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>ELEVENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
NEOSHO COUNTY JAIL*	1948	10	10	7	(01) Inadequate ventilation.** (02) Does not maintain adequate separation of inmates. (03) Inadequate interior lighting.** (04) Inadequate and/or improper plumbing fixtures.** (05) No secure weapons storage.		X X X X	
BAXTER SPRINGS LOCKUP FACILITY* (Cherokee County)	1926	4	4	less than one	(01) Hazardous materials and/or equipment in cell areas.** (02) Inadequate ventilation.** (03) No intercom system between jail office and cell block areas.** (04) Inadequate and/or improper plumbing fixtures.** (05) No security and/or insect screens on windows.** (06) No smoke detector system.** (07) Overall sanitation needs to be improved.	X	X X X X	X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>TWELFTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
LINCOLN COUNTY JAIL*	1930	6	6	less than one	(01) Hazardous materials and/or equipment in cell areas. (02) No detoxification cell.	X	X	
REPUBLIC COUNTY JAIL*	1939	13	7	1	(01) No written safety, security and emergency procedures. (02) Hazardous materials and/or equipment in cell areas.** (03) Cell areas do not maintain fifty-two (52) square feet per inmate.** (04) Inadequate consultation and visitation area.** (05) Inadequate and/or improper plumbing fixtures.** (06) No exercise area.** (07) No standard inmate clothing issued. (08) Painted surfaces need repainting.**	X X	X X X	X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>TWELFTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
WASHINGTON COUNTY JAIL*	1899	4	4	3	(01) Hazardous materials and/or equipment in cell areas. (02) No detoxification cell.** (03) Inadequate processing area.** (04) Inadequate or improper plumbing fixtures.** (05) Does not maintain adequate separation of inmates.**	X	X X X X	

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	THIRTEENTH JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
GREENWOOD COUNTY JAIL*	1957	15	15	6	(01) Does not comply with State Fire Marshal's regulations.** (02) Inadequate ventilation. (03) Does not comply with Department of Health and Environment's standards. (04) No exercise area.** (05) Overall sanitation needs to be improved.	X	X X	X X
AUGUSTA CITY HOLDING FACILITY* (Butler County)	1920	8	3	less than one	(01) Inadequate supervision of inmates. (02) Hazardous materials and/or equipment in cell areas** (03) Cell areas do not maintain fifty-two (52) square feet per inmate.** (04) No detoxification cell. (05) Inadequate administrative space.** (06) Inadequate ventilation.** (07) Inadequate and/or improper plumbing fixtures.** (08) Inadequate interior lighting.** (09) No intercom system between jail office and cell block areas.**	X X	X X X X X X	

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	FOURTEENTH JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESTRIBLE
MONTGOMERY COUNTY JAIL*	1931	52	26	20	(01) Cell areas do not maintain fifty-two (52) square feet per inmate.** (02) No detoxification cell. (03) Inadequate administrative space.** (04) Inadequate ventilation.** (05) Inadequate interior lighting.** (06) Does not maintain adequate separation of inmates.** (07) No security and/or insect screens on windows. (08) No exercise area.** (09) Inadequate food service.** (10) Painted surfaces need repainting.** (11) Overall sanitation needs to be improved.**		X X X X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>FIFTEENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
GRAHAM COUNTY JAIL*	1958	14	8	less than one	(01) Cell areas do not maintain fifty-two (52) square feet per inmate.** (02) Does not maintain adequate separation of inmates.** (03) No exercise area.**		X	X
ROOKS COUNTY JAIL*	1930	8	8	2	(01) Inadequate consultation and visitation area.** (02) Does not maintain adequate separation of inmates.** (03) Painted surfaces need repainting.**		X	X
SHERMAN COUNTY JAIL*	1972	25	25	5	(01) No emergency power.**		X	

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>SIXTEENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
CLARK COUNTY JAIL*	1950	5	3	1	(01) Inadequate supervision of inmates.** (02) Hazardous materials and/or equipment in cell areas** (03) No written safety, security and emergency procedures (04) Inadequate jail staff training.** (05) Inadequate administrative space.** (06) Cell areas do not maintain fifty-two (52) square feet per inmate.** (07) Does not maintain adequate separation of inmates.** (08) No standard inmate clothing issued. (09) No exercise area.**	X X X	X X X	X X
FORD COUNTY JAIL*	1931	38	12	18	(01) Does not comply with State Fire Marshal's regulations. (02) No written safety, security and emergency procedures** (03) Inadequate administrative space.** (04) Inadequate ventilation.** (05) Cell areas do not maintain fifty-two (52) square feet per inmate.** (06) No intercom system between jail office and cell block area.** (07) Does not maintain adequate separation of inmates.** (08) Inadequate interior lighting.** (09) Inadequate jail staff training.** (10) No security and/or insect screens on windows.	X X	X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	SIXTEENTH JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESTRABLE
KIOWA COUNTY JAIL*	1973	9	9	2	(01) Inadequate jail staff training.** (02) No insect and rodent control procedure. (03) Inadequate building maintenance. (04) Inadequate ventilation. (05) Overall sanitation needs to be improved.**		X X X X	X
MEADE COUNTY JAIL*	1933	6	6	less than one	(01) Inadequate supervision of inmates.** (02) Hazardous materials and/or equipment in cell areas** (03) Electrical cords and/or fixtures are accessible to inmates. (04) No written safety, security and emergency procedures.** (05) Inadequate ventilation.** (06) No emergency power. (07) Does not maintain adequate separation of inmates.** (08) Inadequate and/or improper plumbing fixtures. (09) Inadequate jail staff training.** (10) No detoxification cell. (11) No security and/or insect screens on windows. (12) No standard inmate clothing issue.** (13) No exercise area.**	X X X	X X X X X X X	X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	SEVENTEENTH JUDICIAL DISTRICT			
					DEFICIENCIES			
					PRIORITY OF CORRECTIVE ACTION			
					URGENT	NECESSARY	DESIRABLE	
DECATUR COUNTY JAIL*	1981	9	9	less than one	(01) Does not comply with State Fire Marshal's regulations. (02) Inadequate security equipment. (03) No written safety, security and emergency procedures. (04) No intercom system between jail office and cell block areas.	X X X	X	
NORTON COUNTY JAIL*	1981	7	7	3	(01) No written safety, security and emergency procedures. (02) Inadequate security equipment. (03) No written inmate rules.	X X		X
OSBORNE COUNTY JAIL*	1956	7	7	2	(01) Inadequate administrative space.** (02) Inadequate interior lighting.**		X X	
RAWLINS COUNTY JAIL*	1977	10	10	1	(01) Hazardous materials and/or equipment in cell areas.	X		
SMITH COUNTY JAIL*	1976	10	10	2	(01) Hazardous materials and/or equipment in cell areas.	X		

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.

** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>SEVENTEENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
CHEYENNE COUNTY LOCKUP FACILITY*	1924	6	6	less than one	(01) No written safety, security and emergency procedures.** (02) Hazardous materials and/or equipment in cell areas.** (03) Does not comply with the State Fire Marshal's regulations.** (04) Inadequate supervision of inmates.** (05) Inadequate and/or improper plumbing fixtures.** (06) Inadequate administrative space.** (07) No emergency power.** (08) No security and/or insect screens on the cell windows.** (09) No intercom system between jail office and cell block areas.** (10) No standard inmate clothing issue.**	X X X X	X X X X	X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>EIGHTEENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
SEDGWICK COUNTY JAIL*	1958	250	135	197	(01) Cell areas do not maintain fifty-two (52) square feet per inmate.** (02) No cells for mentally or chemically impaired persons. (03) Inadequate interior lighting.** (04) Does not maintain adequate separation of inmates.** (05) No exercise area.** (06) Painted surfaces need repainting.**		X X X X	X X
MULVANE CITY HOLDING FACILITY (Sedgwick County)	1967	2	2	less than one	(01) Overall sanitation needs to be improved.			X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>NINETEENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
BARBER COUNTY JAIL*	1956	6	6	1	(01) Inadequate administrative space.** (02) No emergency power.** (03) No exercise area.**		X X	X
COWLEY COUNTY JAIL*	1963	64	40	35	(01) Cell areas do not maintain fifty-two (52) square feet per inmate.** (02) No standard inmate clothing issue.** (03) No exercise area.**		X	X X
SUMNER COUNTY JAIL*	1951	31	18	21	(01) Does not comply with State Fire Marshal's regulations.** (02) Cell areas do not maintain fifty-two (52) square feet per inmate.** (03) No detoxification cell.** (04) Inadequate interior lighting. (05) No security and/or insect screens on windows.** (06) No exercise area.** (07) No floor drains in cell block area.** (08) Painted surfaces need repainting.	X	X X X X	X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	TWENTIETH JUDICIAL DISTRICT DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESTRALBLE
BARTON COUNTY JAIL*	1954	30	30	20	(01) Security equipment in need of repair or replacement. (02) Inadequate administrative space.** (03) Does not maintain adequate separation of inmates.** (04) Inadequate interior lighting. (05) Inadequate and/or improper plumbing fixtures.** (06) No exercise area.** (07) Painted surfaces need repainting.** (08) Overall sanitation needs to be improved.**	X	X X X X	X X X
ELLSWORTH COUNTY JAIL*	1980	13	13	5	(01) Inadequate supervision of inmates. (02) Hazardous materials and/or equipment in cell areas.	X X		
RICE COUNTY JAIL*	1929	26	14	5	(01) Inadequate supervision of inmates.** (02) Does not comply with State Fire Marshal's regulations.** (03) Inadequate ventilation. (04) Cell areas do not maintain fifty-two (52) square feet per inmate.** (05) Inadequate and/or improper plumbing fixtures.** (06) No detoxification cell. (07) Inadequate consultation and visitation area. (08) Inadequate jail staff training.**	X X	X X X X X	

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	TWENTIETH JUDICIAL DISTRICT			
					DEFICIENCIES			
					PRIORITY OF CORRECTIVE ACTION			
					URGENT	NECESSARY	DESTRIBLE	
RICE COUNTY JAIL* (Continued)					(09) No standard inmate clothing issue.** (10) No exercise area.** (11) No floor drains in cell block areas.** (12) Painted surfaces need repainting.			X X X X
RUSSELL COUNTY JAIL*	1957	22	14	2	(01) Inadequate supervision of inmates.** (02) Hazardous materials and/or equipment in cell areas.** (03) Security equipment in need of repair or replacement.** (04) No written safety, security and emergency procedures.** (05) Inadequate ventilation.** (06) Cell areas do not maintain fifty-two (52) square feet per inmate.** (07) No emergency power.** (08) Inadequate interior lighting. (09) Inadequate and/or improper plumbing fixtures.** (10) No security and/or insect screens on windows.** (11) No secure storage for weapons. (12) Inadequate heating devices.** (13) Inadequate jail staff training. (14) No exercise area.** (15) Painted surfaces need repainting. (16) No written inmate rules. (17) Overall sanitation needs to be improved.**	X X X X	X X X X X X X X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	TWENTY-SECOND JUDICIAL DISTRICT	PRIORITY OF CORRECTIVE ACTION		
					DEFICIENCIES	URGENT	NECESSARY	DESIRABLE
DONIPHAN COUNTY JAIL*	1957	14	7	4	(01) Does not comply with State Fire Marshal's regulations.** (02) No written safety, security and emergency procedures. (03) Inadequate ventilation. (04) Inadequate interior lighting. (05) Inadequate and/or improper plumbing fixtures.** (06) No security and/or insect screens on windows. (07) No standard inmate clothing issue.** (08) No exercise area.**	X X	 X X X X	 X X
MARSHALL COUNTY JAIL*	1979	16	16	5	(01) Security equipment in need of repair or replacement.	X		
HORTON CITY HOLDING FACILITY* (Brown County)	1914	3	3	less than one	(01) No emergency power. (02) No intercom system between jail office and cell block areas.** (03) No security and/or insect screens on windows.**		X X	 X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<p style="text-align: center;">TWENTY-THIRD JUDICIAL DISTRICT</p> <p style="text-align: center;">DEFICIENCIES</p>	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
ELLIS COUNTY JAIL*	1975	36	36	8	(01) Does not comply with Department of Health and Environment standards.		X	
OAKLEY CITY LOCKUP FACILITY* (Logan County)	1948	3	3	3	(01) Inadequate administrative space.** (02) Inadequate ventilation.** (03) Inadequate interior lighting.** (04) Inadequate and/or improper plumbing fixtures.** (05) Inadequate kitchen facilities.**		X X X X X	

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>TWENTY-FOURTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
EDWARDS COUNTY JAIL*	1928	11	11	2	(01) Inadequate supervision of inmates.** (02) Hazardous materials and/or equipment in cell areas.** (03) Inadequate jail staff training.** (04) No exercise area.** (05) Painted surfaces need repainting.**	X X	X	X X
HODGEMAN COUNTY JAIL*	1927	8	6	less than one	(01) Insufficient emergency exits.** (02) Hazardous materials and/or equipment in cell areas.** (03) No written safety, security and emergency procedures.** (04) Inadequate ventilation.** (05) Inadequate jail staff training.** (06) Inadequate bedding issue.** (07) No security and/or insect screens on windows.** (08) No exercise area.** (09) No floor drains.**	X X X	X X X X	X X
LANE COUNTY JAIL*	1935	8	8	1	(01) Inadequate and/or improper plumbing fixtures.**		X	

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<p style="text-align: center;">TWENTY-FOURTH JUDICIAL DISTRICT</p> <p style="text-align: center;">DEFICIENCIES</p>	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
NESS COUNTY JAIL*	1955	6	6	less than one	(01) Hazardous materials and/or equipment in cell areas.** (02) Inadequate jail staff training.** (03) Inadequate food preparation area.	X	X X	
PAWNEE COUNTY JAIL*	1952	15	15	4	(01) No written safety, security and emergency procedures.** (02) Electrical cords and/or fixtures are accessible to inmates. (03) No intercom system between jail office and cell block areas.** (04) Inadequate and/or improper plumbing fixtures. (05) No exercise area.**	X X	X X	X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<p style="text-align: center;">TWENTY-FIFTH JUDICIAL DISTRICT</p> <p style="text-align: center;">DEFICIENCIES</p>	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
KEARNY COUNTY JAIL*	1965	21	15	2	(01) No written safety, security and emergency procedures.** (02) Inadequate administrative space.** (03) No security and/or insect screens on windows.** (04) No exercise area.**	X	X	X
SCOTT COUNTY JAIL*	1948	12	6	4	(01) Inadequate supervision of inmates. (02) No written safety, security and emergency procedures. (03) Improper control of tools and equipment. (04) Cell areas do not maintain fifty-two (52) square feet per inmate.** (05) Inadequate processing area. (06) Does not maintain adequate separation of inmates.** (07) No holding cell.** (08) Inadequate interior lighting.** (09) Improper plumbing fixtures.** (10) No security and/or insect screens on windows.** (11) Inadequate jail staff training.** (12) No exercise area.** (13) Painted surfaces need repainting.**	X X X	X X X X X X X	X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<p style="text-align: center;">TWENTY-SIXTH JUDICIAL DISTRICT</p> <p style="text-align: center;">DEFICIENCIES</p>	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
GRANT COUNTY JAIL*	1972	22	22	1	(01) No emergency power.** (02) Inadequate interior lighting.** (03) Painted surfaces need repainting.**		X X	X
MORTON COUNTY JAIL*	1964	13	9	less than one	(01) Inadequate supervision of inmates.** (02) Does not comply with State Fire Marshal's regulations. (03) No written safety, security and emergency procedures. (04) Inadequate administrative space.** (05) Cell areas do not maintain fifty-two (52) square feet per inmate.** (06) No emergency power.** (07) No intercom system between jail office and cell block areas.** (08) No security and/or insect screens on windows.** (09) Inadequate jail staff training.** (10) No exercise area.**	X X X	X X X X X	X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>TWENTY-SIXTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
SEWARD COUNTY JAIL*	1957	48	31	14	(01) No written safety, security and emergency procedures.** (02) Cell areas do not maintain fifty-two (52) square feet per inmate.** (03) Improper consultation and visitation area. (04) No emergency power. (05) Bathing facilities need repair and cleaning. (06) Painted surfaces need repainting.	X	X	X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

CONTINUED

1 OF 2

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>TWENTY-SEVENTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
RENO COUNTY JAIL*	1971	65	65	41	(01) Inadequate interior lighting.** (02) No exercise area.**		X	X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<u>TWENTY-EIGHTH JUDICIAL DISTRICT</u> DEFICIENCIES	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
OTTAWA COUNTY JAIL*	1912	7	4	2	(1) Cell areas do not maintain fifty-two (52) square feet per inmate.** (2) No detoxification cells, no segregation cells, no maximum security cells. (3) Inadequate administrative space.** (4) Inadequate and improper lighting fixtures.** (5) Inadequate jail staff training. (6) No emergency power. (7) No security and/or insect screens on windows.** (8) No exercise area.**		X	
SALINE COUNTY JAIL*	1962	73	73	44	(1) No exercise area.**			X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

NAME OF FACILITY	DATE CONSTRUCTED	CAPACITY	RECOMMENDED CAPACITY	AVERAGE DAILY POPULATION	<p style="text-align: center;">TWENTY-NINTH JUDICIAL DISTRICT</p> <p style="text-align: center;">DEFICIENCIES</p>	PRIORITY OF CORRECTIVE ACTION		
						URGENT	NECESSARY	DESIRABLE
WYANDOTTE COUNTY JAIL*	1929	125	55	79	(01) Inadequate supervision of inmates. (02) Does not comply with State Fire Marshal's regulations.** (03) Inadequate ventilation.** (04) Cell areas do not maintain fifty-two (52) square feet per inmate. (05) Inadequate interior lighting.** (06) Does not comply with Kansas Department of Health and Environment recommendations.** (07) No detoxification cells.** (08) Painted surfaces need repainting.** (09) Overall sanitation needs to be improved.** (10) No security and/or insect screens on windows.**	X X	X X X X	X X X X

* Reports from either the State Fire Marshal's Office or the State Department of Health and Environment are available.
 ** This deficiency existed in previous inspection reports but no corrective action has been taken.

MOST COMMON DEFICIENCIES ENCOUNTERED

DEFICIENCIES	Priority of Corrective Action		
	Urgent	Necessary	Desirable
1 Inadequate supervision of inmates.	15		
2 Does not comply with State Fire Marshal's regulations.	16		
3 Hazardous materials and/or equipment in cell areas.	23		
4 Security equipment in need of repair or replacement.	5		
5 Electrical cords and/or fixtures are accessible to inmates.	9		
6 No written safety, security and emergency procedures.	17		
7 Inadequate administrative space.		19	
8 Inadequate ventilation.		18	
9 Cell areas do not maintain fifty-two (52) square feet per inmate.		25	
10 No emergency power.		15	
11 No intercom system between jail office and cell block areas.		9	
12 Does not maintain adequate separation of inmates.		20	
13 Inadequate interior lighting.		23	
14 Inadequate and/or improper plumbing fixtures.		25	
15 No security and/or insect screens on windows.		19	
16 Inadequate jail staff training.		12	
17 No standard inmate clothing issued.			12
18 No exercise area.			33
19 No floor drains in cell block areas			7
20 Painted surfaces need repainting.			20
21 Overall sanitation needs to be improved.			10
22 All other deficiencies.	7	51	9
TOTAL For each Level of Corrective Action	92	236	91
TOTAL Deficiencies			419

END